


TOP VIEW

ALTERNATE INLETS $\phi 5'$ - USE ONE OF THREE KNOCKOUTS

TONGUE & GROOVE JOINT WITH POLYPROPYLENE BASED SEALER

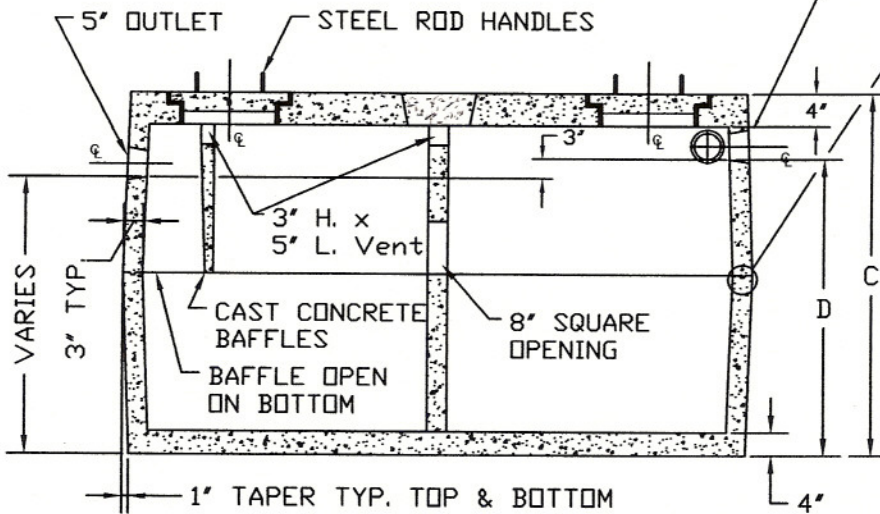

SECTION A-A

NOTES:

- EXCAVATION MUST BE AT LEAST 12" WIDER & LONGER THAN TANK SIZE.
- REINFORCED WITH 12.5 GA. 4" X 4" GALVANIZED WIRE & 3/8" RE-ROD.

LIQUID GALS.	A	B	C	D
	WIDTH	LENGTH	HEIGHT	INVERT
1000	62"	96"	65"	55"
1250	62"	96"	75"	65"

Bush
CONCRETE PRODUCTS, INC.
 3584 Airline Rd * Muskegon, MI * (231) 733-1904

1250 gal. 2 Compartment Septic Tank

SIZE A	DATE 12/13/04	DWG NO. 006	REV
DRAWN BY: S. GARABEDIAN		SHEET 1 of 1	