
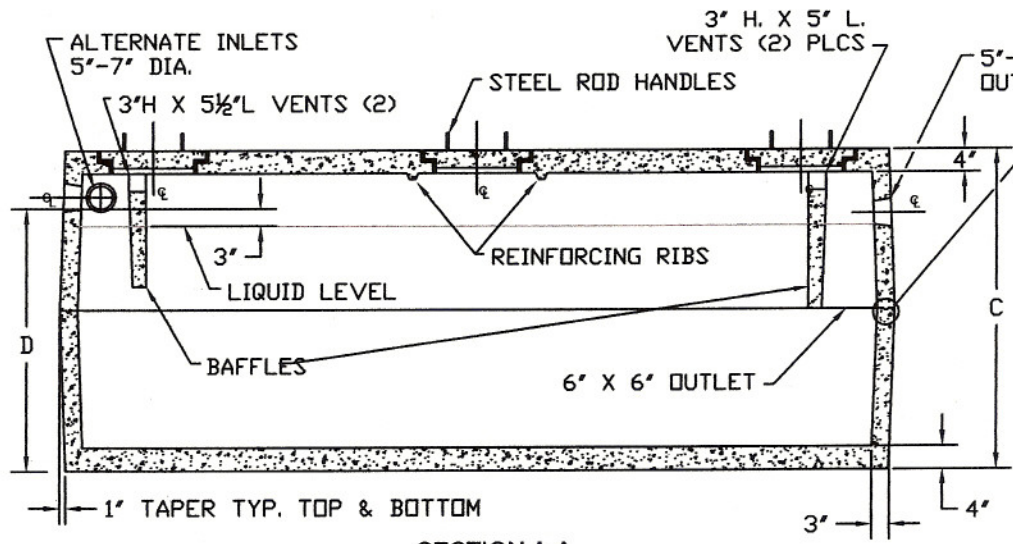


TOP VIEW

TONGUE & GROOVE JOINT WITH POLYPROPYLENE BASESEALER



SECTION A-A

NOTES:

1. EXCAVATION MUST BE AT LEAST 12" WIDER & LONGER THAN TANK SIZE.
2. REINFORCED WITH 12.5 GA. 4" X 4" GALVANIZED WIRE & 1/2" RE-ROD.

\* SEE PAGE 2 FOR CENTER SECTION DETAILS AND DIMENSIONS.



3584 Airline Road  
Muskegon, Michigan 49444

1600-4000gal. Septic Tank

SIZE	DATE	DWG NO.	REV
A	12/14/05	009	
DRAWN BY: S. GARABEDIAN		SHEET	1 of 2